
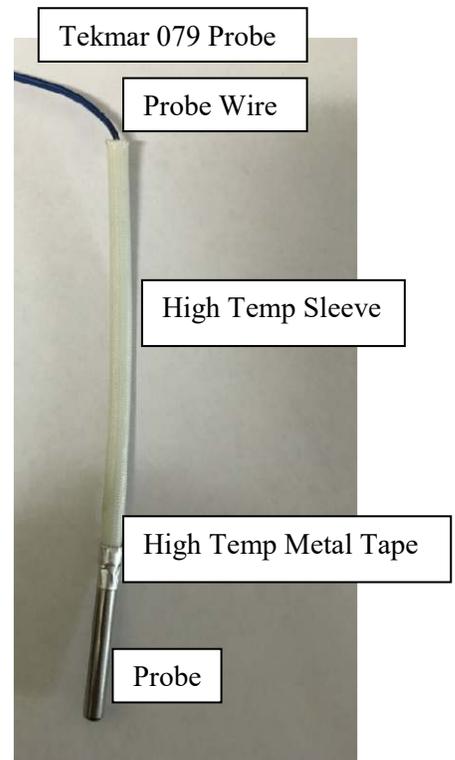
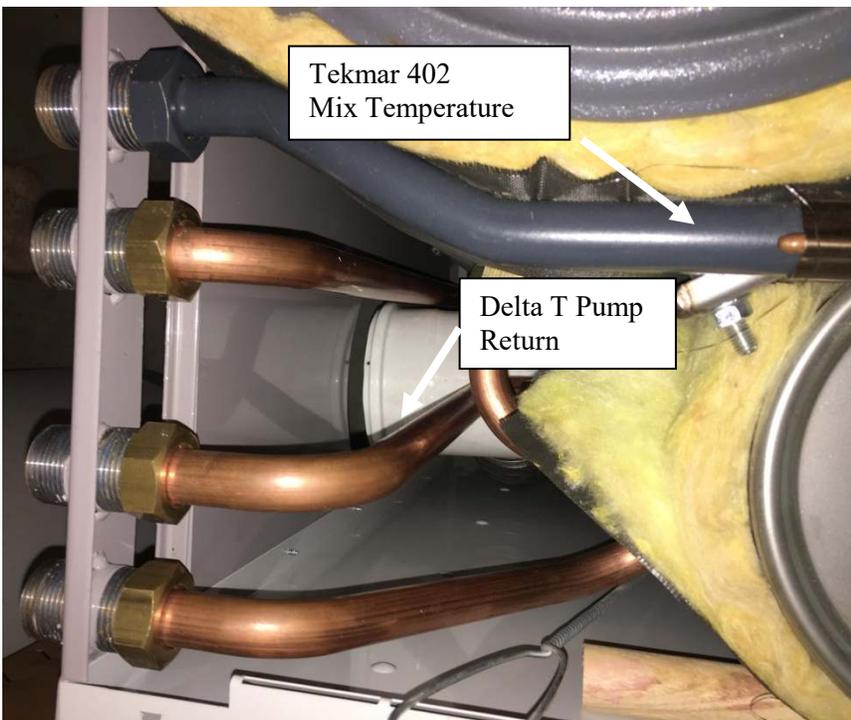


Probe Locations Delta T Pumps and Controls

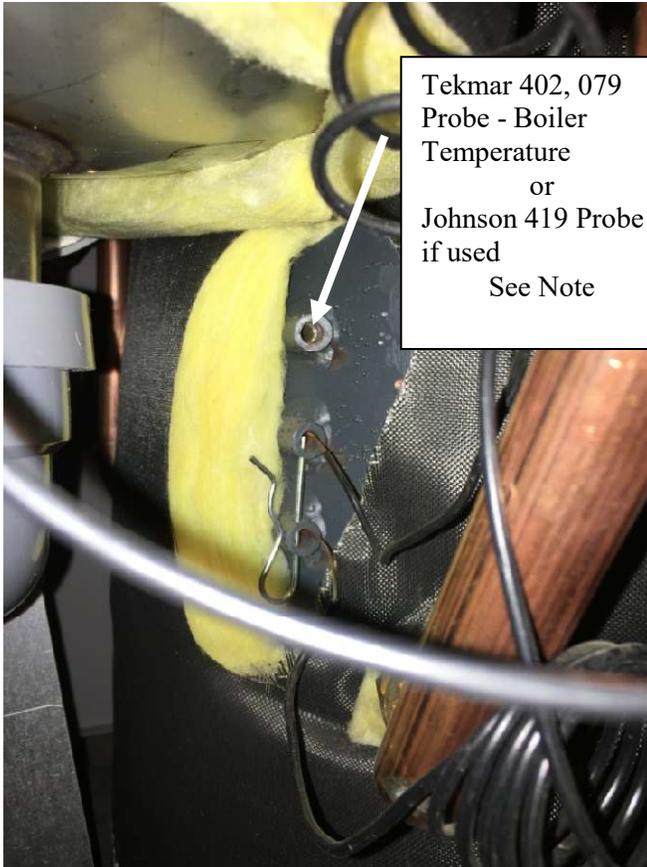

Note: Tekmar Boiler Temperature Probe needs to be a 10,000 ohm type 2, and no larger than about 3/16" in diameter. A Tekmar 079 will work. If using the Johnson 419 the 1/4" probe will work only by drilling out well to 9/32. A 12" long bit is needed if not disassembled.